



TOP VIEW

- NOTES:  
 SEE ROOF CURB DWG. # 60-1  
 1. 1 1/2 INLET AND DISCHARGE FLANGES.  
 2. SERVICE ACCESS PANELS MUST NOT BE  
 OBSTRUCTED RECOMMENDED CLEARANCE 24 INCHES.  
 3. DIMENSIONS ARE SUBJECT TO MANUFACTURING TOLERANCES.  
 FOR REFERENCE USE ONLY, SUBJECT TO CHANGE WITHOUT NOTICE.

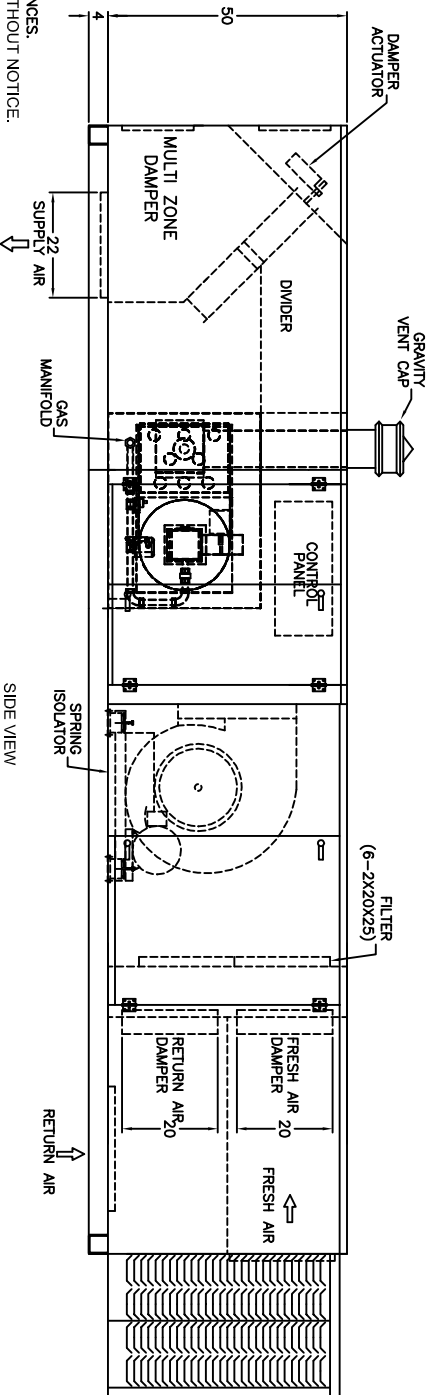

SIDE VIEW

				<div><div></div><div>WESTERN</div></div>					TITLE		
				HTDM 400 HORIZONTAL CONFIG. OUTDOOR UNIT GRAVITY VENTED C/W FLAT FILTER SECTION MIX BOX w/ RELIEF AND MULTI ZONE SUPPLY			DRW. NO. P00002			PAGE J-23	
				DRAWN BY GDD	ISSUED BY	SCALE					
				CHK. BY	DATE		JOB NO.				