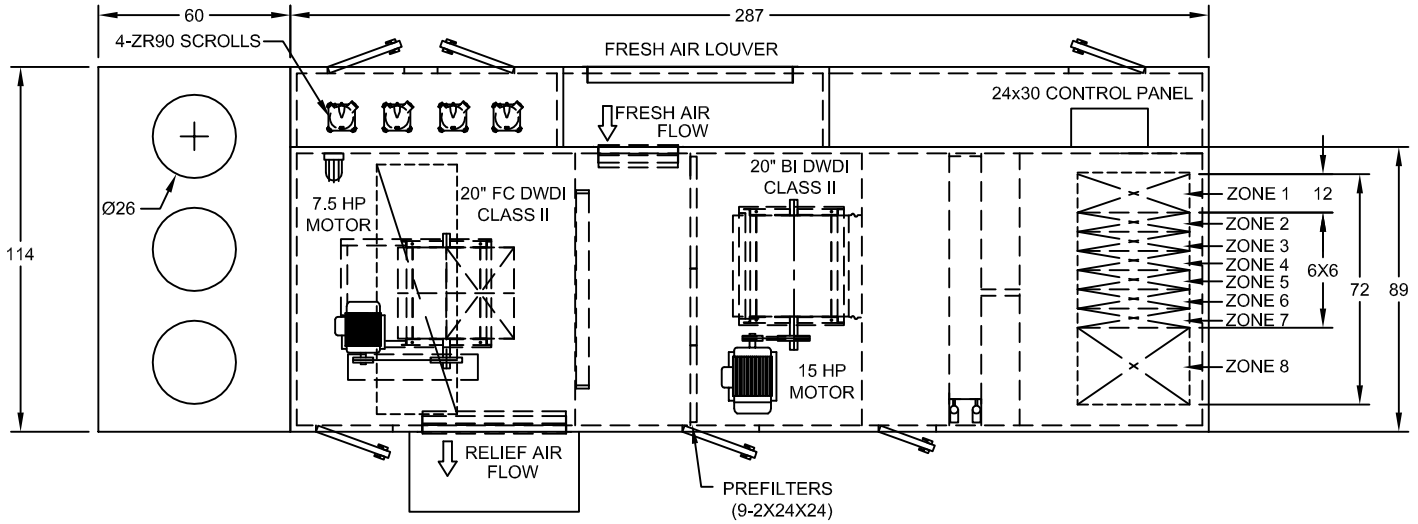

TOP VIEW

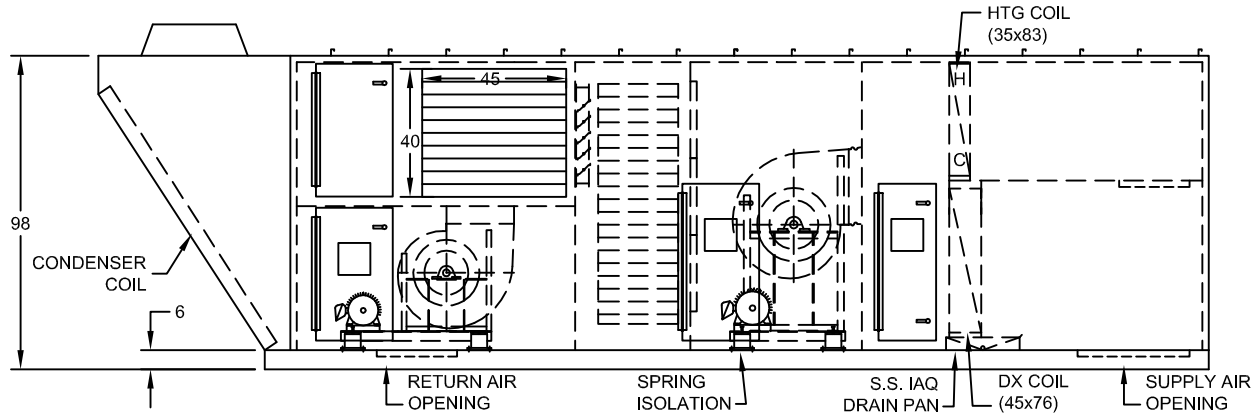

SIDE VIEW

NOTES:

1. 1 1/2 INLET AND DISCHARGE DUCT FLANGES
2. SERVICE ACCESS PANELS MUST NOT BE OBSTRUCTED RECOMMENDED CLEARANCE 24 INCHES.
3. DIMENSIONS ARE SUBJECT TO MANUFACTURING TOLERANCES. FOR REFERENCE USE ONLY, SUBJECT TO CHANGE WITHOUT NOTICE

Rev	By	Revision Description	Date

WESTERN SALES

TITLE
12,000CFM ROOFTOP AIR HANDLING UNIT (MULTIZONE)
MIXING BOX c/w RELIEF, HEATING WATER COILS, PACKAGED DX COOLING, RETURN AIR BLOWER, SUPPLY AIR BLOWER
MODEL: AH-120-BI-R/A-RO-DX30MZ

DRAWN BY	ISSUED BY	SCALE	DRW. NO.	
		1/5"=1'		
CHK. BY	DATE		JOB NO.	PAGE J-14